

ADDENDUM NO. 5

For, GRAVITY INJECTION WELLS Phase V

ST 0902 Bid Documents

To All Bidders:

The following change is hereby made part of Gravity Injection Wells Phase V, as fully as completely as if the same were set forth therein:


1. Delete the following drawings and replace with attached drawings
 - C-14
 - C-15
 - C-16
 - C-18

Direct any request for Information to Richard Evans Perez Engineering; revans@perezeng.com

All Bidders shall acknowledge receipt and acceptance of this Addendum No.5 by acknowledging Addendum in their proposal or by submitting the addendum with the bid package. Bids submitted without the acknowledgement or without this Addendum may be considered non-responsive.

Signature

Name of Business

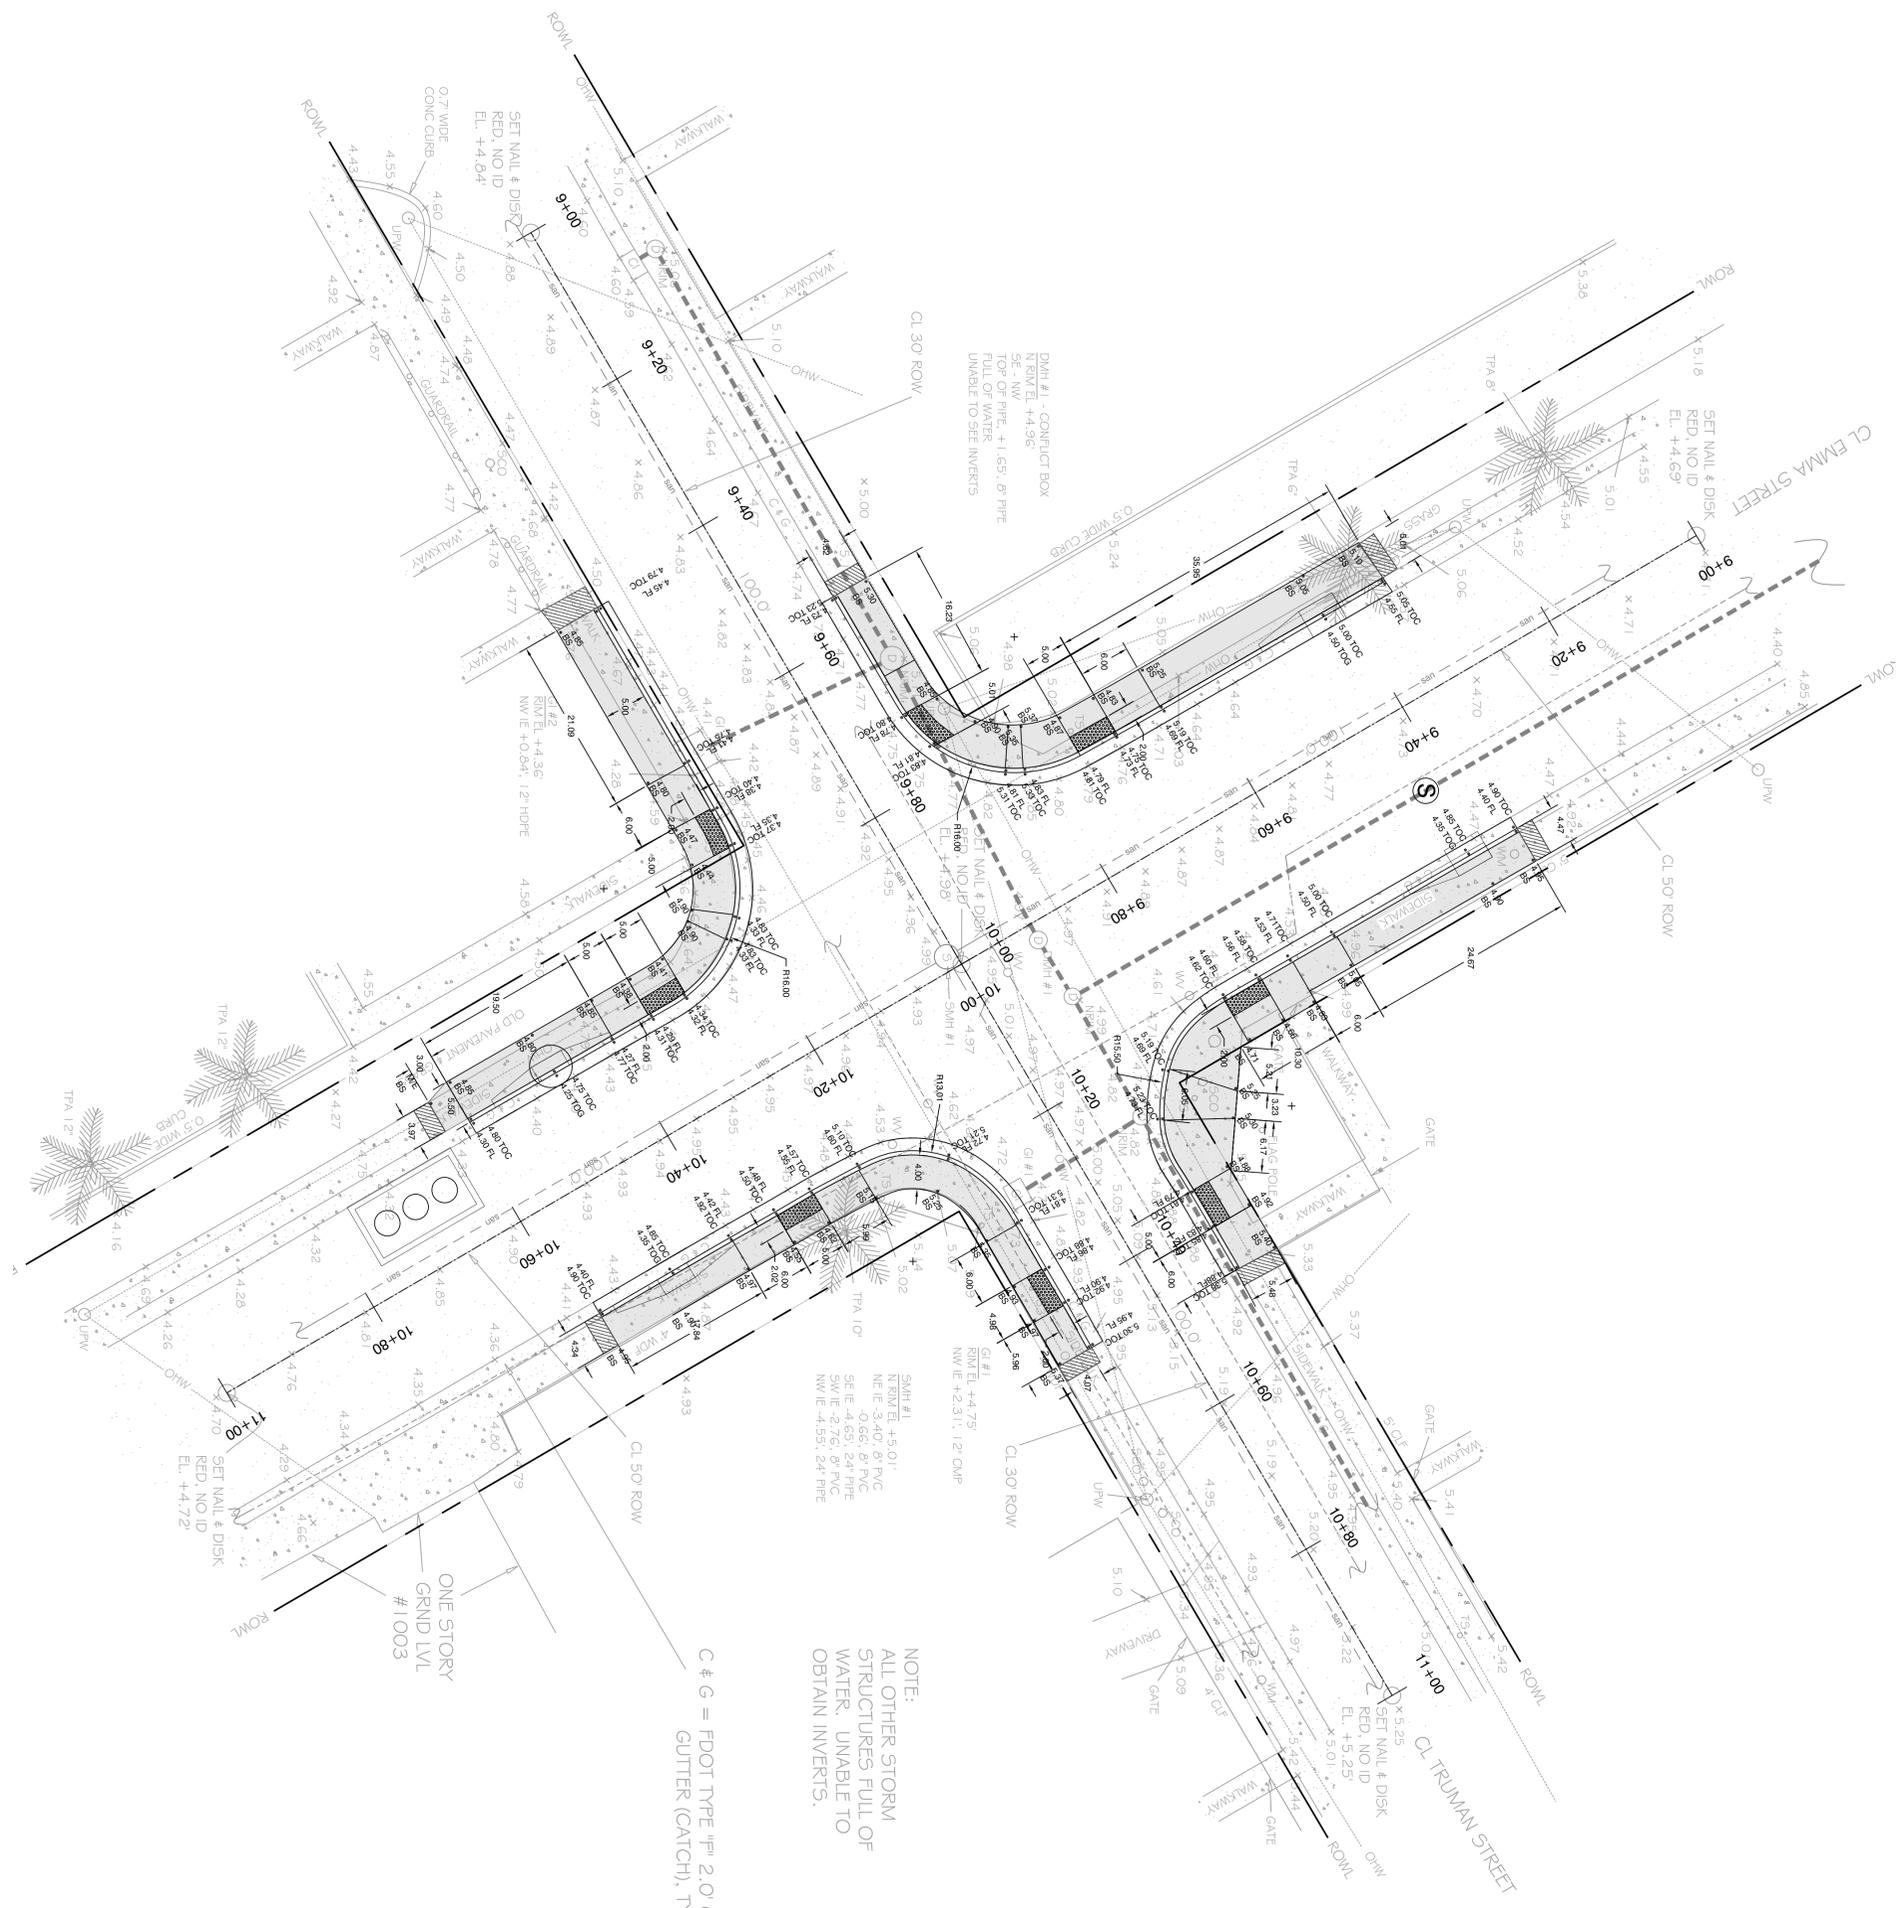


NOTE:
ALL OTHER STORM
STRUCTURES FULL OF
WATER, UNABLE TO
OBTAIN INVERTS.

C & G = FOOT TYPE "F" 2.0 CURB &
GUTTER (CATCH), TYP.

LEGEND	
[Symbol]	FL FLOW LINE
[Symbol]	EGP EDGE OF PAVEMENT
[Symbol]	TOC TOP OF CURB
[Symbol]	TS TOP OF GATE
[Symbol]	FS FRONT OF SIDEWALK
[Symbol]	BS BACK OF SIDEWALK
[Symbol]	TOA TOE OF APRON
[Symbol]	TOP TOP OF RAMP
[Symbol]	ADA DETECTABLE WARNING
[Symbol]	LANDSCAPE AREA (SOD)
[Symbol]	SPECIAL TRANSITION FROM CONCRETE TO NONCONCRETE WITH SLOPE MAXIMUM OF 1:12

- NOTE:
1. CONTRACTOR TO REESTABLISH ALL BENCHMARKS AND PROPERTY CORNERS.
 2. CONTRACTOR RESPONSIBLE FOR VERIFYING EXISTING ELEVATIONS PRIOR TO SIDEWALK CURB DEMOLITION.
 3. SIDEWALK CROSS SLOPE 2% MAX.
 4. SIDEWALKS TO SLOPE TOWARD ROADWAY.
 5. SIDEWALK RUNNING SLOPE SHALL BE NO GREATER THAN 1:20.
 6. RAMP RUNNING SLOPE SHALL BE NO GREATER THAN 1:12.
 7. RAMP CROSS SLOPE 2% MAX.
 8. CONTRACTOR RESPONSIBLE FOR PROPER DRAINAGE WHERE NEW ASPHALT IS PROVIDED.
 9. RAMP SHALL HAVE 1/4" DIFFERENCE BETWEEN END OF RAMP AND PAVEMENT TRANSITION AREAS SHALL HAVE MAXIMUM OF 1:20 SLOPE. TRANSITION AREAS SHALL EXTEND AS NECESSARY TO MATCH EXISTING AND PROVIDE COMPLIANT RUNNING SLOPE.



091023
JOB NO.
DRAWN R/M
DESIGNED AEP
CHECKED AEP
SHEET 00

CITY OF KEY WEST
627 PALM AVENUE
KEY WEST, FLORIDA
(305)292-8161

GRAVITY INJECTION WELLS, PHASE V
BID PLANS
EMMA ST. & TRUMAN ST.
ADA SIDEWALK PLAN

REVISIONS:	DATE
1. BID PLANS REVISED (PHASE 1)	11/10/09
2. BID PLANS REVISED (PHASE 2)	11/12/09
3.	
4.	
5.	
6.	

ORIGINAL: DECEMBER 2008
ALLEN E. PEREZ, P.E.
Florida P.E. NO. 51468
November 12, 2009

CIVIL ENGINEERING • REGULATORY PERMITTING • CONSTRUCTION MANAGEMENT

KEY WEST OFFICE
1010 EAST KENNEDY DRIVE, SUITE 400
KEY WEST, FLORIDA 33040
TEL: (305) 293-9440 FAX: (305) 296-0243

TAMPA OFFICE
CONCOURSE CENTER
3507 EAST FRONTAGE ROAD, SUITE 140
TAMPA, FLORIDA 33607
TEL: (813) 579-1616 FAX: (813) 288-0710

PEREZ ENGINEERING & DEVELOPMENT, INC.
CERTIFICATE OF AUTHORIZATION NO. 8579



SCALE 1"=10'
 BAR IS TWO INCHES ON ORIGINAL DRAWINGS IF
 NOT TWO INCHES ON THIS SHEET ADJUST
 SCALES ACCORDINGLY

LEGEND	
FL	FLOW LINE
EOP	EDGE OF PAVEMENT
TOC	TOP OF CURB
TOG	TOP OF GRATE
FS	FRONT OF SIDEWALK
BS	BACK OF SIDEWALK
TOA	TOE OF APRON
TOR	TOP OF RAMP
	ADA DETECTABLE WARNING
	LANDSCAPE AREA (SOD)
	SIDEWALK TRANSITION FROM COMPLIANT TO NON-COMPLIANT

NOTE: SYMBOLS IN LEGEND ARE NOT TO SCALE

- NOTE:
- CONTRACTOR TO REESTABLISH ALL BENCHMARKS AND PROPERTY CORNERS.
 - CONTRACTOR RESPONSIBLE FOR VERIFYING EXISTING ELEVATIONS PRIOR TO SIDEWALK/CURB DEMOLITION.
 - SIDEWALK CROSS SLOPE 2% MAX.
 - SIDEWALKS TO SLOPE TOWARD ROADWAY.
 - SIDEWALK RUNNING SLOPE SHALL BE NO GREATER THAN 1:20.
 - RAMP RUNNING SLOPE SHALL BE NO GREATER THAN 1:12.
 - RAMP CROSS SLOPE 2% MAX.
 - CONTRACTOR RESPONSIBLE FOR PROPER DRAINAGE WHERE NEW ASPHALT IS PROVIDED.
 - RAMPS SHALL HAVE 1/4" DIFFERENCE BETWEEN END OF RAMP AND PAVEMENT ELEVATION.
 - TRANSITION AREAS SHALL HAVE MAXIMUM OF 1:20 SLOPE. TRANSITION AREAS SHALL EXTEND AS NECESSARY TO MATCH EXISTING AND PROVIDE COMPLIANT RUNNING SLOPE.

CIVIL ENGINEERING • REGULATORY PERMITTING • CONSTRUCTION MANAGEMENT

PEREZ ENGINEERING & DEVELOPMENT, INC.

KEY WEST OFFICE
 1010 EAST KEY WEST DRIVE, SUITE 400
 KEY WEST, FLORIDA 33040
 TEL: (305) 293-9440 FAX: (305) 296-0243

TAMPA OFFICE
 CONCOURSE CENTER
 3507 EAST FRONTAGE ROAD, SUITE 140
 TEL: (813) 579-1616 FAX: (813) 288-0710

ALLEN E. PEREZ, P.E.
 Florida P.E. NO. 51468
 November 13, 2009

REVISIONS:	ORIGINAL: DECEMBER 2008
1	2D PLANS REVISED (PHASE 1) 11/07/09
2	2D PLANS REVISED (PHASE 2) 11/12/09
3	
4	
5	
6	

GRAVITY INJECTION WELLS, PHASE V

BID PLANS

MARGARET ST. & EATON ST.

ADA SIDEWALK PLAN



CITY OF KEY WEST

627 PALM AVENUE

KEY WEST, FLORIDA

(305)292-8161

JOB NO.	091023
DRAWN	RTM
DESIGNED	AEP
CHECKED	AEP
QC	

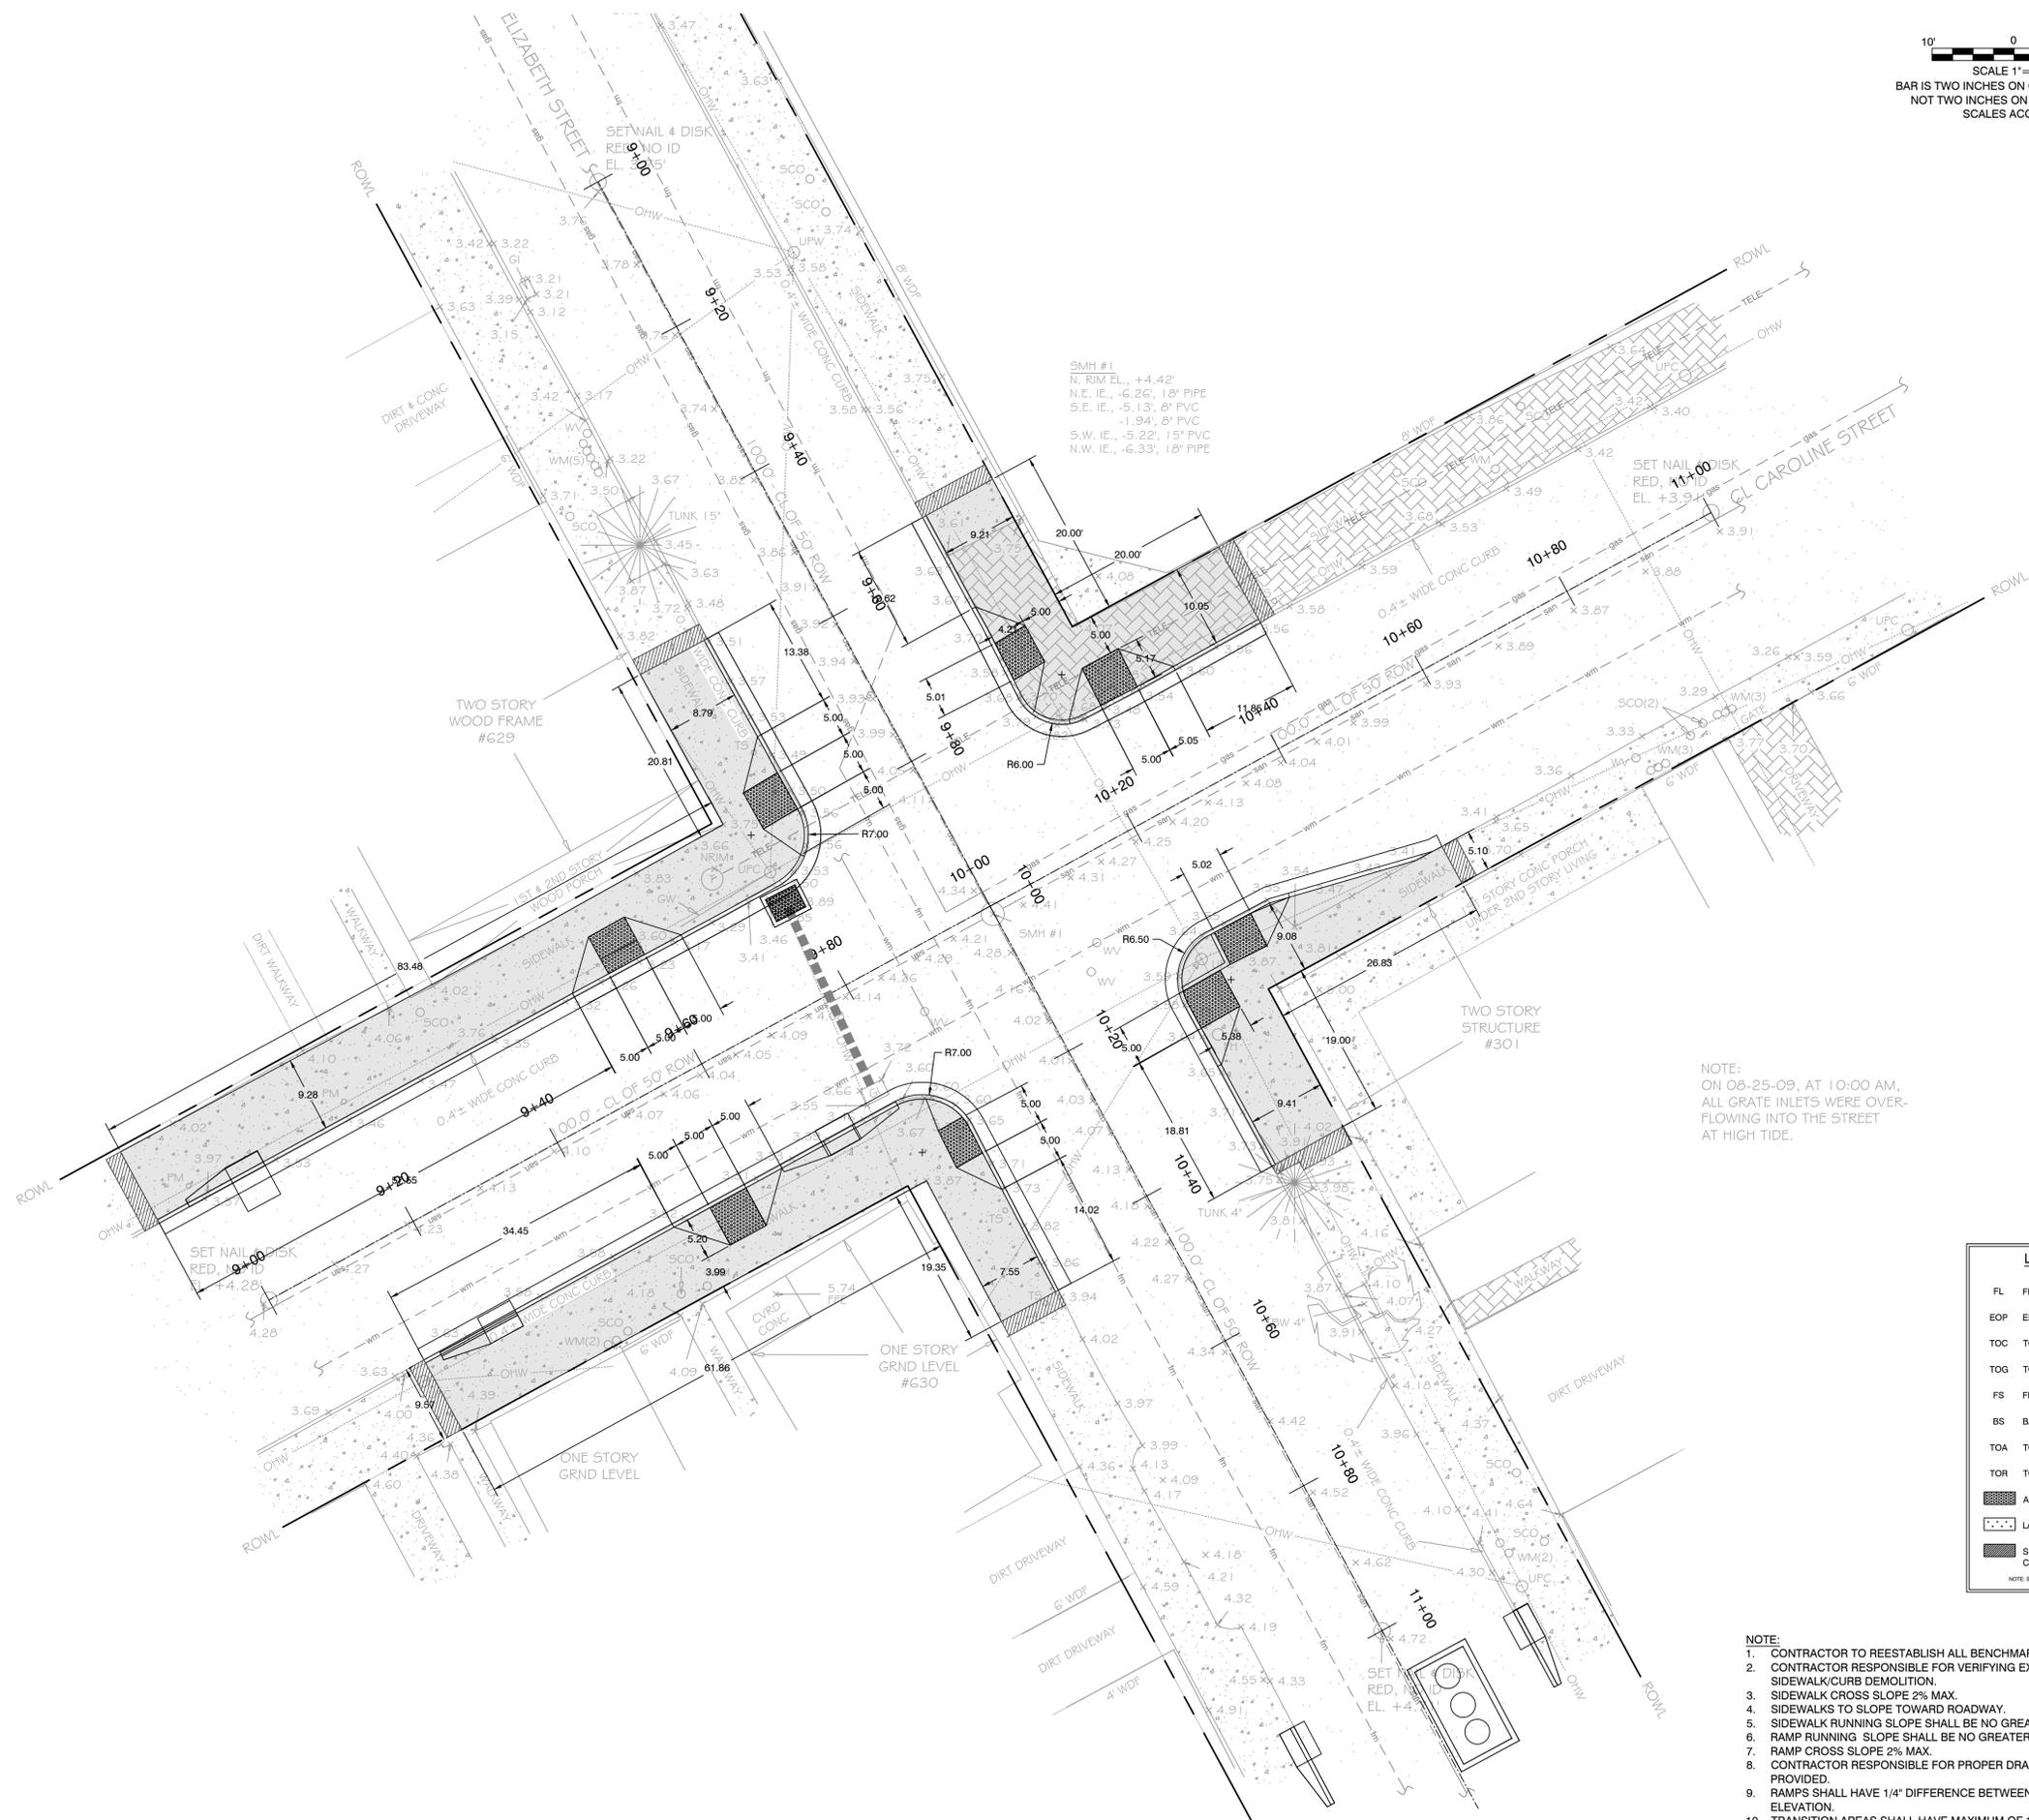

LEGEND	
FL	FLOW LINE
EOP	EDGE OF PAVEMENT
TOC	TOP OF CURB
TG	TOP OF GRATE
FS	FRONT OF SIDEWALK
BS	BACK OF SIDEWALK
TOA	TOE OF APRON
TOR	TOP OF RAMP
[Pattern]	ADA DETECTABLE WARNING
[Pattern]	LANDSCAPE AREA (SOD)
[Pattern]	SIDEWALK TRANSITION FROM COMPLIANT TO NON-COMPLIANT

NOTE: SYMBOLS IN LEGEND ARE NOT TO SCALE

- NOTE:
- CONTRACTOR TO REESTABLISH ALL BENCHMARKS AND PROPERTY CORNERS.
 - CONTRACTOR RESPONSIBLE FOR VERIFYING EXISTING ELEVATIONS PRIOR TO SIDEWALK/CURB DEMOLITION.
 - SIDEWALK CROSS SLOPE 2% MAX.
 - SIDEWALKS TO SLOPE TOWARD ROADWAY.
 - SIDEWALK RUNNING SLOPE SHALL BE NO GREATER THAN 1:20.
 - RAMP RUNNING SLOPE SHALL BE NO GREATER THAN 1:12.
 - RAMP CROSS SLOPE 2% MAX.
 - CONTRACTOR RESPONSIBLE FOR PROPER DRAINAGE WHERE NEW ASPHALT IS PROVIDED.
 - RAMPS SHALL HAVE 1/4" DIFFERENCE BETWEEN END OF RAMP AND PAVEMENT ELEVATION.
 - TRANSITION AREAS SHALL HAVE MAXIMUM OF 1:20 SLOPE. TRANSITION AREAS SHALL EXTEND AS NECESSARY TO MATCH EXISTING AND PROVIDE COMPLIANT RUNNING SLOPE.

REVISIONS:

1	ED PLANS REVISED (PHASE 1)	11/07/09
2	ED PLANS REVISED (PHASE 2)	11/12/09
3		
4		
5		
6		

ORIGINAL: DECEMBER 2008

CITY OF KEY WEST
627 PALM AVENUE
KEY WEST, FLORIDA
(305)292-8161

BID PLANS
CAROLINE ST. & ELIZABETH ST.
ADA SIDEWALK PLAN

CONSTRUCTION MANAGEMENT
KEY WEST OFFICE
1010 EAST KENNEDY DRIVE, SUITE 400
KEY WEST, FLORIDA 33040
TEL: (305) 293-9440 FAX: (305) 296-0243
TAMPA OFFICE
CONCOURSE CENTER
3507 EAST FRONTAGE ROAD, SUITE 140
TEL: (813) 579-1616 FAX: (813) 288-0710

ALLEN E. PEREZ, P.E.
Florida P.E. NO. 51468
November 12, 2009

PEREZ ENGINEERING & DEVELOPMENT, INC.

JOB NO. 091023

DRAWN RTM

DESIGNED AEP

CHECKED AEP

QC

SHEET

C-16

