


PLAN

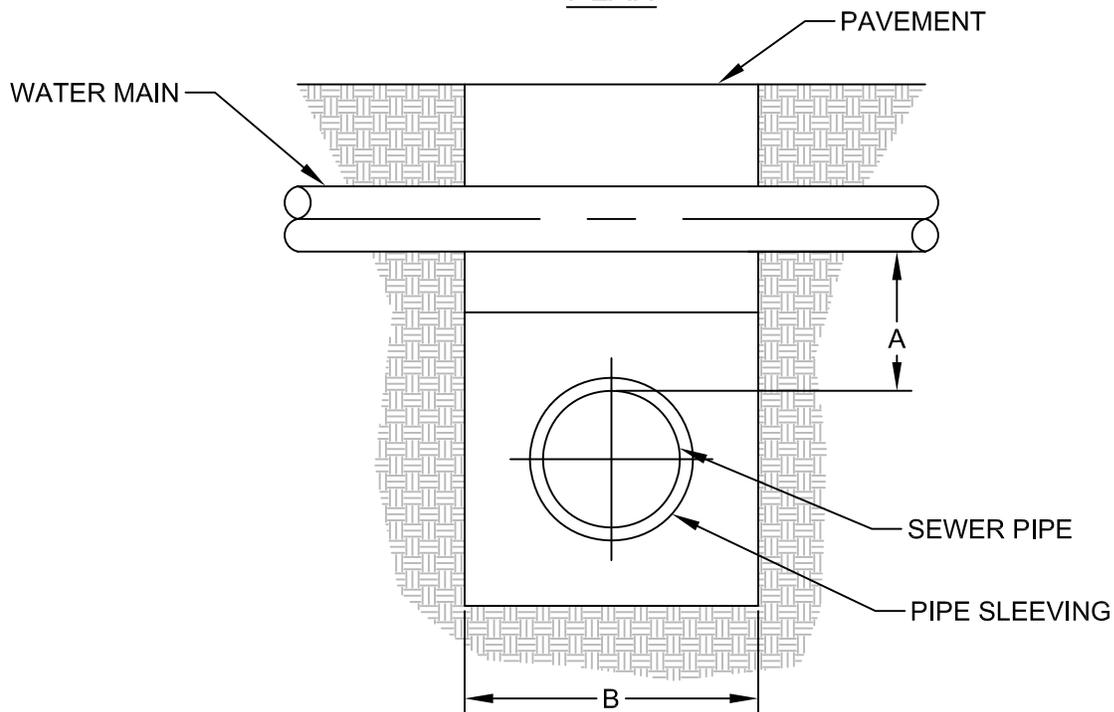

SECTION

**NOTE:**

1. AT NO TIME SHALL A WATER MAIN BE ALLOWED UNDER A SEWER, SEWER LATERAL, OR STORM DRAIN UNLESS APPROVED BY THE FLORIDA KEYS AQUEDUCT AUTHORITY.
2. "A" - WHEN LESS THAN 18" , SLEEVING IS REQUIRED AS SHOWN
3. "B" - PIPE OUTSIDE BARREL DIAMETER +12"
4. PIPE SLEEVE SHALL BE 2" GREATER IN NOMINAL PIPE DIAMETER THAN SEWER SERVICE LATERAL.



City of Key West

Engineering Services  
3132 Flagler Avenue, Key West, FL 33040

TITLE

ENCASEMENT - ALTERNATE FOR

DRAWN  
JTJ  
SCALE  
NTS

SEWER LATERALS

JUL 2015  
DETAIL

16